

The City of San Marcos
Engineering and Capital Improvements


STANDARD FIRE HYDRANT

RECORDED COPY SIGNED BY
LAURIE MOYER, P.E.

6-30-2015
ADOPTED

THE ARCHITECT/ENGINEER ASSUMES
RESPONSIBILITY FOR APPROPRIATE
USE OF THIS STANDARD

511S-17-SM
N.T.S. STANDARD DETAIL

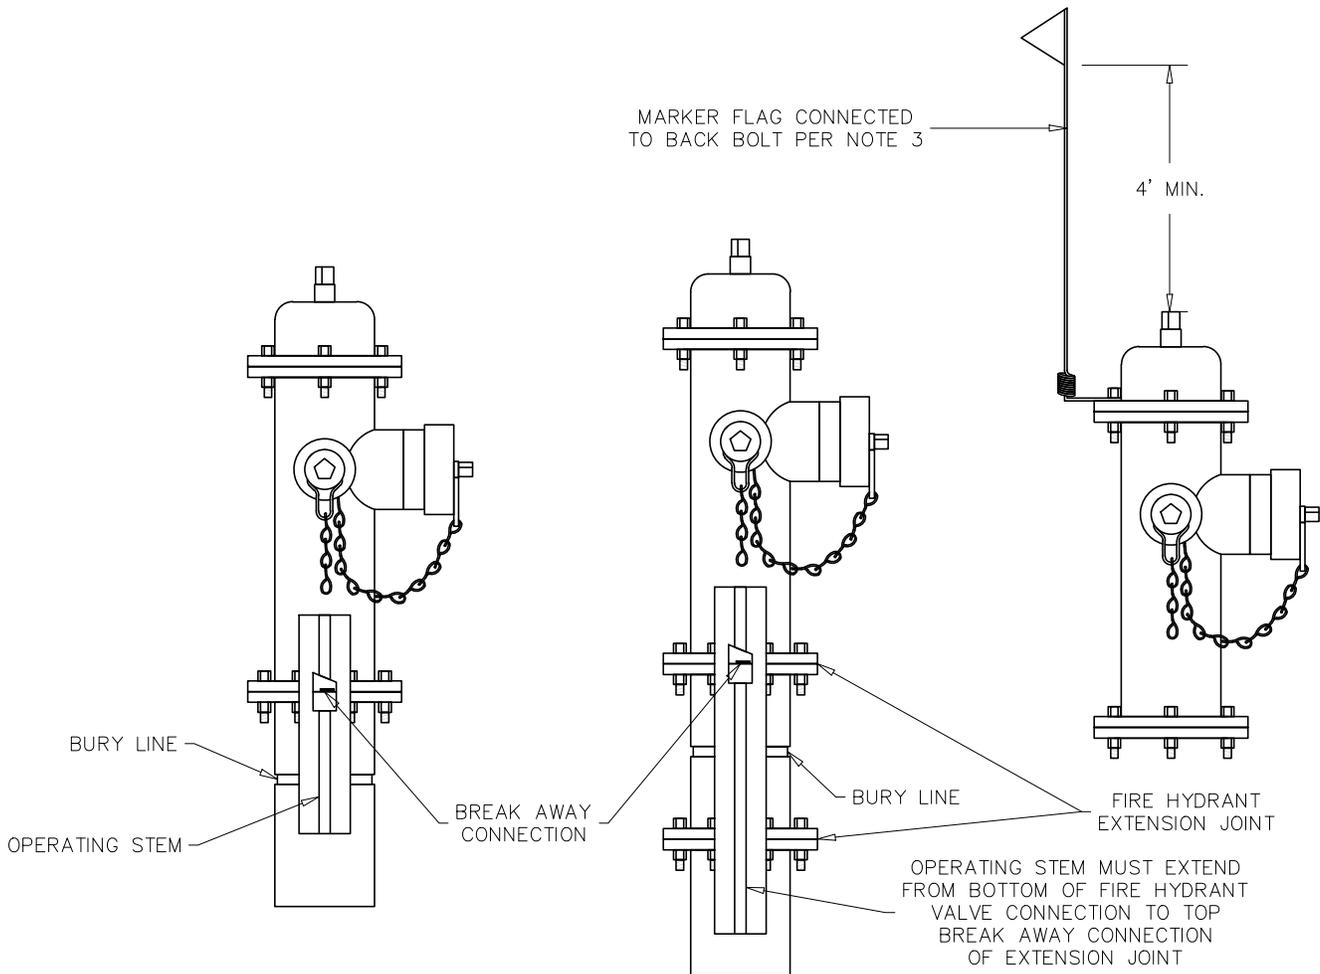

NOTES:

1. PUBLIC HYDRANTS SHALL BE FACTORY PAINTED WITH BRIGHT ALUMINUM BASED SILVER PAINT AND PRIVATE HYDRANTS SHALL BE PAINTED RED.
2. A BLUE REFLECTIVE PAVEMENT MARKER MUST BE PLACED WITH EVERY FIRE HYDRANT ADJACENT TO A ROADWAY 6"-10" OFF CENTER LINE OF ROAD ON FIRE HYDRANT SIDE.
3. FIRE HYDRANTS OUTSIDE ROW SHALL HAVE MARKING FLAGS IN RURAL AREAS.
4. FIRE HYDRANT MUST GO ON PAVEMENT SIDE OF FENCE, OR FENCE MUST BE REBUILT AROUND FIRE HYDRANT TO ALLOW ACCESS FROM PAVEMENT TO FIRE HYDRANT.
5. FIRE HYDRANT MAY ONLY MINIMALLY OBSTRUCT SIDEWALK AT EITHER EDGE
6. NO OBJECT THAT WILL OBSTRUCT MAINTENANCE OR USE OF THE FIRE HYDRANT WILL BE LOCATED WITH IN 5 FEET OF THE FIRE HYDRANT INCLUDING BUT NOT LIMITED TO (TREE, BUSH, FENCE, TELEPHONE POLE, DUMPSTER, PERMANENT/NONPERMANENT STRUCTURE,...ETC.).
7. FIRE HYDRANT ASSEMBLY MUST BE PER CURRENT CITY OF SAN MARCOS STANDARD PRODUCT LIST.

REFERENCE
DETAIL 520S-WMT-SM

SHT 2 OF 2

The City of San Marcos
Engineering and Capital Improvements

STANDARD FIRE HYDRANT

RECORDED COPY SIGNED BY
LAURIE MOYER, P.E.

6-30-2015
ADOPTED

THE ARCHITECT/ENGINEER ASSUMES
RESPONSIBILITY FOR APPROPRIATE
USE OF THIS STANDARD

511S-17-SM
N.T.S. STANDARD DETAIL